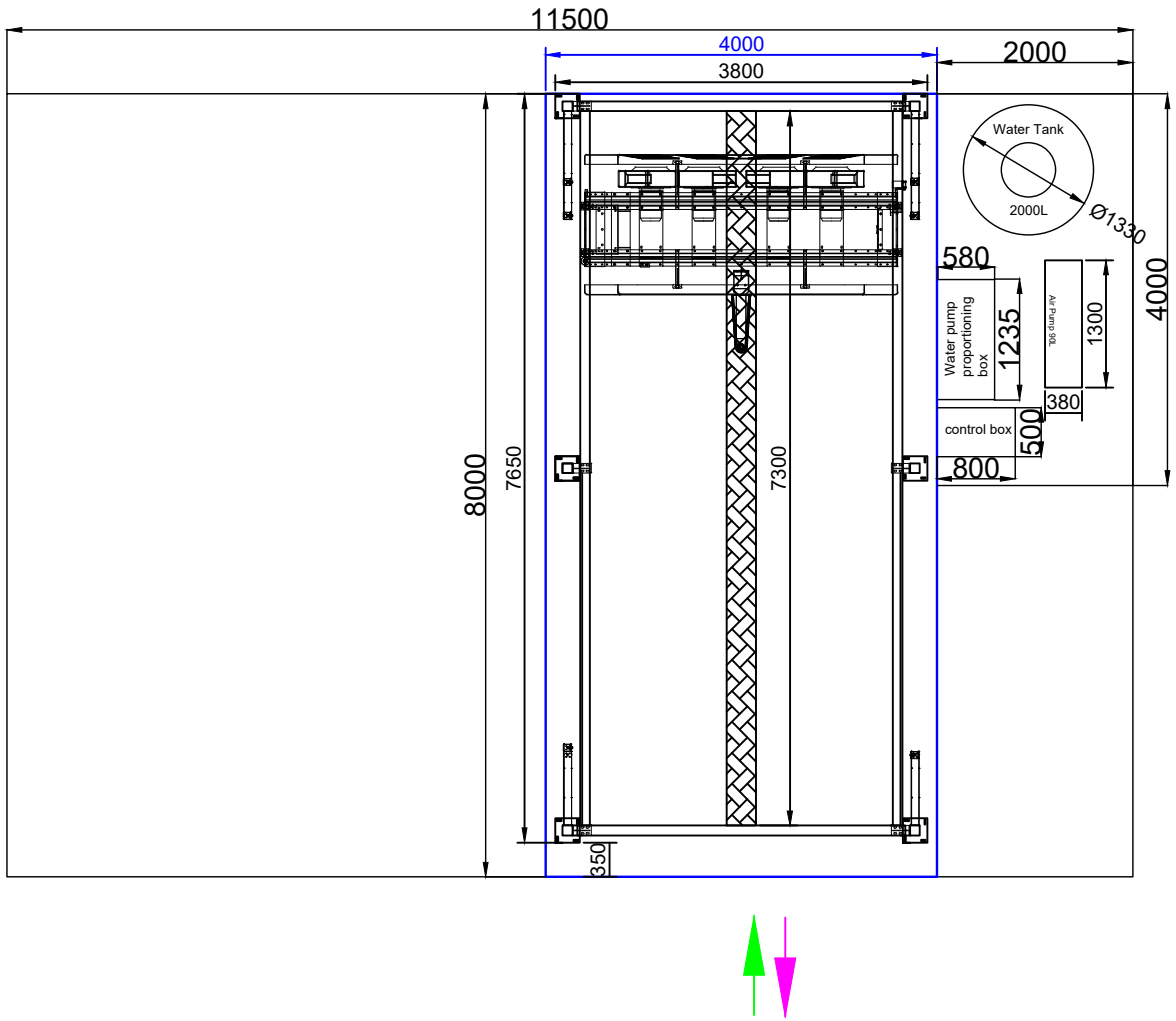


Washing room
1. Single unit size L8M*W4M*H3.3M
2.Construction and installation of equipment should be car ried out after the concrete has completely set,The ground flatness requires a work deviation of no more than 3 centimeters
3.Need to set up drainage ditch
4.The thickness of ground concrete is more than 150mm
Control room
1.Single unit size L4M*W2M
2.The control room is equipped with 380V Three-phase five-wire, Single phase voltage 220V power frequency 50-60Hz
3.100A industrial 4P independent circuit breaker is required between the main power supply and the equipment
4.The closer it is to the washing workshop, the better,b ut ensure that water and moisture cannot enter the control room.